


NOTES

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES, SEE DWG. E-1.
FOR INSTALLATION DETAILS, SEE DWGS. E-2 AND E-4. FOR WIRING
DIAGRAMS, SEE DWGS. E-3 AND E-4.
2. NOT USED
3. NOT USED
4. FOR RETURN AIR SMOKE DETECTORS ARRANGEMENT AND NOTES,
SEE DWG M-1.
5. NOT USED.

THE PORT AUTHORITY
OF NY & NJ

[Signature]
ENGINEERING PROGRAM MANAGER
ELECTRICAL
CHIEF ELECTRICAL ENGINEER

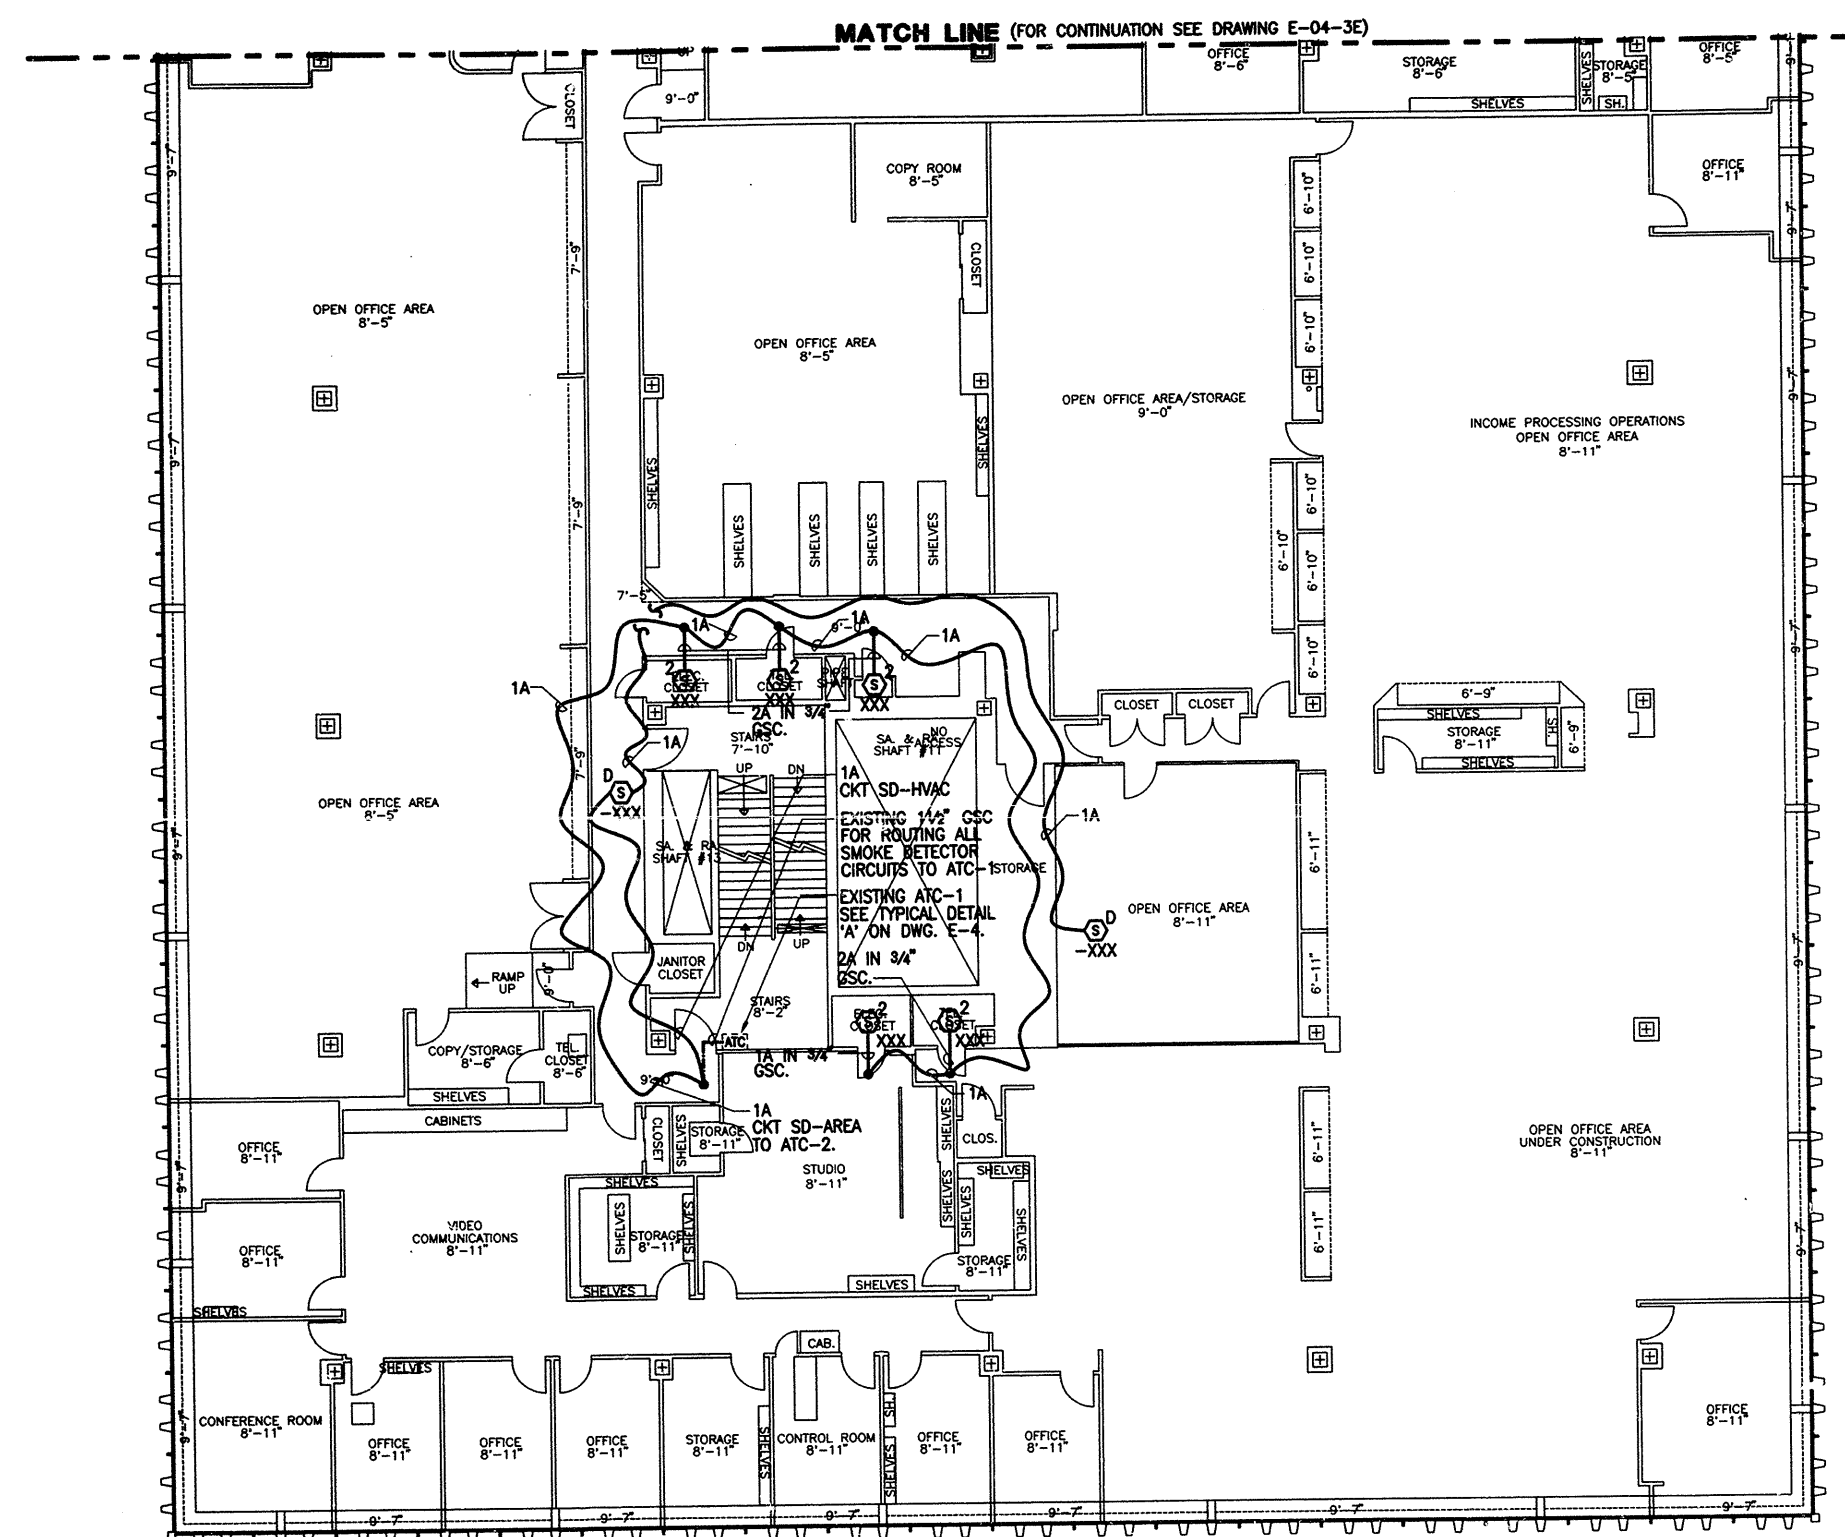


No.	Date	Revision	Approved
ENGINEERING DEPARTMENT			
WORLD TRADE CENTER			
ELECTRICAL			

ENGINEERING DEPARTMENT			
WORLD TRADE CENTER			
ELECTRICAL			

4th FLOOR
SMOKE DETECTOR
LAYOUT INSTALLATION,
SOUTH PART PLAN

I HEREBY CERTIFY THAT THIS IS A TRUE AND
CORRECT COPY OF ONE OF THE CONTRACT
DRAWINGS CONSTITUTING A PART OF
CONTRACT NO. WTC-861.573 IN
THE FORM IN WHICH SAID DRAWINGS
EXISTED AT THE TIME THE SAID CONTRACT
WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 *[Signature]*
DATE 2/18/00 *[Signature]*
CONTRACT ARCHITECT
ENGINEERING PROGRAM MGR.

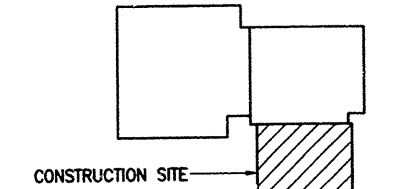

CONSTRUCTION SITE
KEY PLAN
N.T.S.
SCALE IN FEET
0 12 24

This drawing subject to conditions in Contract. All
inventions, ideas, designs and methods herein are
reserved to Port Authority and may not be used
without its written consent.

FELDSSTEIN APOSTLE A.S.
Designed by Drawn by Checked by

NOVEMBER 26, 1999
Date

WTC-861.573 E-04-3S
Contract Number Drawing Number